

Glazing Must Be To This Drawing - Do NOT Mix Glazing Systems Even If They Appear The Same


Notes:

Details Taken From Moralt Firesound 44 Global Assessment  
CNA/F14274 Revision B Valid Until 09/12/2024


Maximum Glaze Area = 0.9m²

Apertures At A Minimum Of 165mm From Any Door Edge

Minimum 135mm Of Core Material Between Apertures

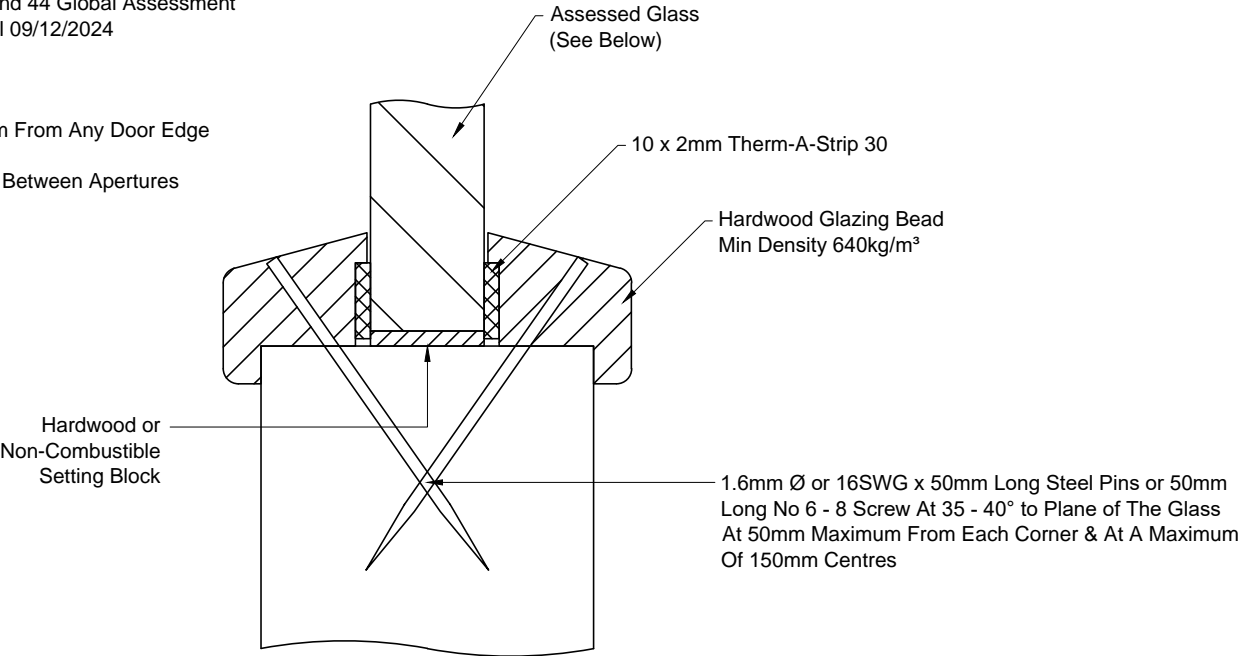

Bead Profile - See DP20762



Quality Standard Of Glazed Aperture To Work Instruction - WI\_21


Only Employees With A Signed Training Record For This Glazing System To Use This Glazing System

Approved Glass - See Global Assessment CNA/F14274 Revision B					
Glass Type	Material Specification For Glass	Beading Drawing	Material Specification For Beading	Maximum Area (m²)	
Pyrostop 30-10	MS_006	DP20762	MS_007	0.9	Machined Aperture 5mm Larger Than Glass

Do Not Scale.

If In Doubt Ask!

Description: Glazing System - 15mm PyroStop 30-10 - Moralt Firesound 44 - FD30

Drawn By: P. Brash	Approved: Approved	Date: 20/09/2022	Drawing No:	 Unit 6, Ranskill Court, Sheffield, S9 5FZ
Size: See Above	Tolerance: +/- 0.5mm	Fire Rating: FD30S	DP20761	
Cert No: CNA/F14274 Rev B	© Doorpac Ltd		REV 00	