



Glazing Must Be To This Drawing - Do NOT Mix
Glazing Systems Even If They Appear The Same

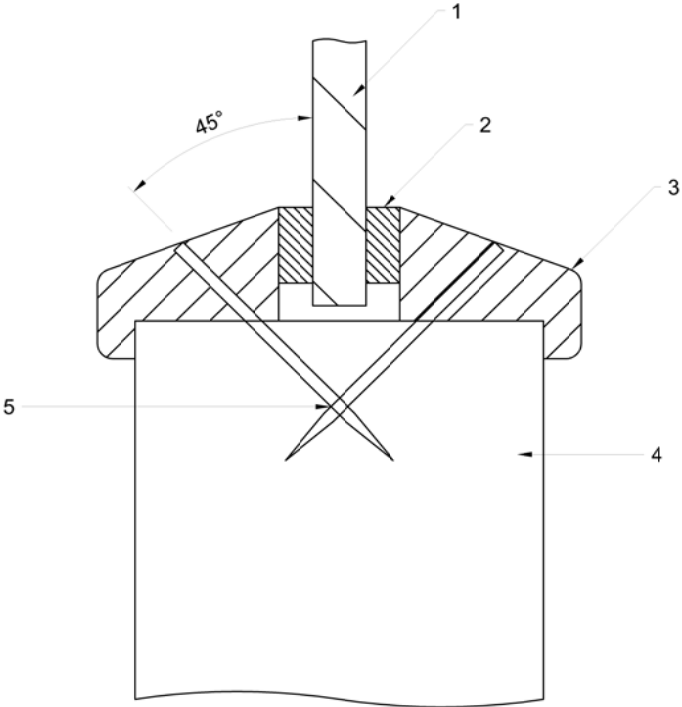

Bead Profile - See DP19885

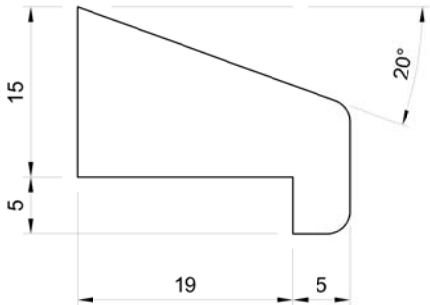

Key:-

- 1. 7mm Pyroguard Glass
- 2. 10mm Wide x 5mm Thick Sealmaster Intumescent Foam Glazing Tape
- 3. 20mm High (Including 5 x 5mm Minimum Bolection With 20° Chamfer) Hardwood Glazing Bead, Minimum Density 620kg/m³
- 4. Nominal 54mm Thick FD30 Door Leaf
- 5. Ø1.6 x 40mm Long Steel Pins Or No 8 x 40mm Long Steel Screws At A Maximum Of 150mm Centres, 45° To The Vertical & A Nominal 50mm From Each Corner

Quality Standard Of Glazed Aperture To Work Instruction - WI_21


Only Employees With A Signed Training Record For This Glazing System To Use This Glazing System

Approved Glass - See CF257							
Glass Type	Material Specification For Glass	Beading Drawing	Material Specification For Beading	Maximum Height (mm)	Maximum Width (mm)	Maximum Area (m²)	
7mm Pyroguard	MS_006	DP19885	MS_007	1846	760	1.31	Machined Aperture 5mm Larger Than Glass

Do Not Scale.

If In Doubt Ask!

Description: 10 x 5mm Sealmaster Intumescent Foam Glazing Tape - Glazing System - 7mm Pyroguard- FD30 54mm Strebord Core

Drawn By: P. Brash	Approved: Approved	Date: 01/10/2021	Drawing No: DP19884	 Unit 6, Ranskill Court, Sheffield, S9 5FZ
Size: See Aboce	Tolerance: +/- 0.5mm	Fire Rating: FD30S	REV 00	
Cert No: CF257	© Doorpac Ltd			