



**Glazing Must Be To This Drawing - Do NOT Mix Glazing Systems Even If They Appear The Same**

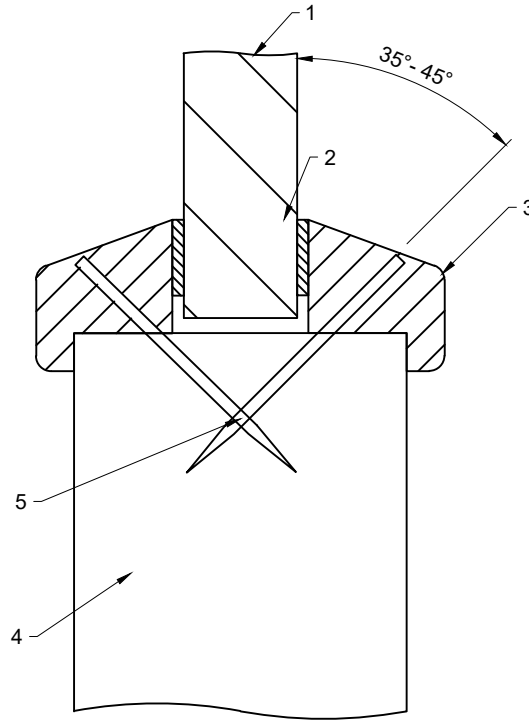

Bead Profile - See DP23293

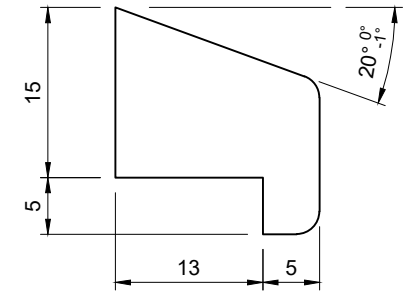

Key:-

1. Approved Glass - 15mm Pyroguard
2. 10mm Wide x 2mm Thick Pyrostrip 300 (Interdens)
3. 20mm High (Including 5 x 5mm Minimum Belection With 20° Chamfer) Hardwood Glazing Bead, Minimum Density 620kg/m³
4. Nominal 44mm Thick FD30 Door Leaf
5. Ø1.6 x 40mm Long Steel Pins Or Ø4 x 40mm Long Steel Screws At A Maximum Of 150mm Centres, 35-45° To The Vertical & A Nominal 50mm From Each Corner

Quality Standard Of Glazed Aperture To Work Instruction - WI\_21


Only Employees With A Signed Training Record For This Glazing System To Use This Glazing System

Approved Glass - See Below								
Approved Glass	Glass Certificate	Material Specification For Glass	Beading Drawing	Material Specification For Beading	Maximum Height (mm)	Maximum Width (mm)	Maximum Area (m²)	
15mm Pyroguard	CF257	MS_006	DP23293	MS_007	1846	760	1.31	Machined Aperture 5mm Larger Than Glass

Do Not Scale.

If In Doubt Ask!

Description: **Glazing System - 15mm Pyroguard - 44mm Thick Palusol Panelled door**

Drawn By: <b>M.Oxley</b>	Approved: <b>Approved</b>	Date: <b>12/12/2024</b>	Drawing No: <b>DP23292</b>	
Size: <b>See Above</b>	Tolerance: <b>+/- 0.5mm</b>	Fire Rating: <b>FD30S</b>	<b>REV 00</b>	
Cert No: <b>CF257 - Pyroguard &amp; PAR/2451/01</b>	© Doorpac Ltd			