



Glazing Must Be To This Drawing - Do NOT Mix Glazing Systems Even If They Appear The Same

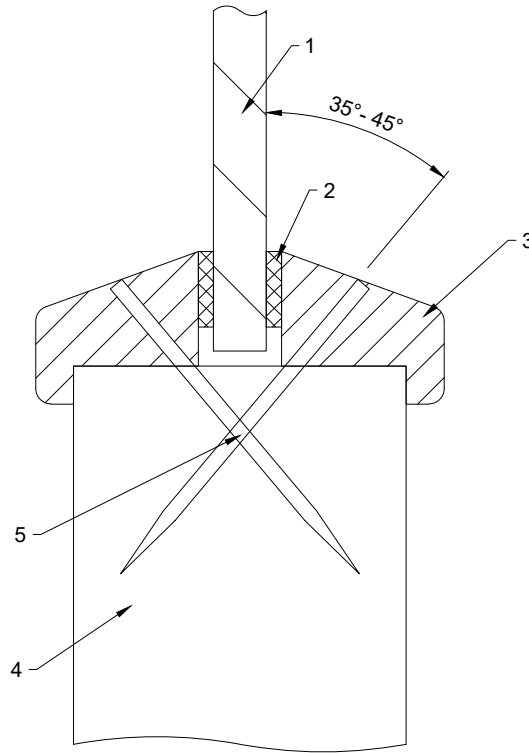

Bead Profile - See DP23729

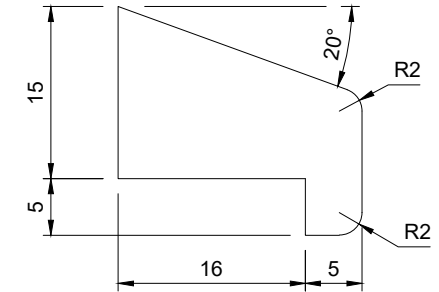

Key:-

1. Approved Glass - 7mm Pyroguard
2. 10mm Wide x 2mm Thick Pyrostrip 300 (Interdens)
3. 20mm High (Including 5 x 5mm Minimum Belection With 20° Chamfer) Hardwood Glazing Bead, Minimum Density 640kg/m³
4. Nominal 44mm Thick FD30 Door Leaf
5. Ø1.6 x 40mm Long Steel Pins Or Ø4 x 40mm Long Steel Screws At A Maximum Of 150mm Centres, 35-45° To The Vertical & A Nominal 50mm From Each Corner

Quality Standard Of Glazed Aperture To Work Instruction - WI_21

Only Employees With A Signed Training Record For This Glazing System To Use This Glazing System

Approved Glass - See Below							
Approved Glass	Glass Certificate	Material Specification For Glass	Beading Drawing	Material Specification For Beading	Maximum Height (mm)	Maximum Width (mm)	Machined Aperture Width 5mm Larger & Height 7mm Larger Than Glass
7mm Pyroguard	CF257	MS_006	DP23729	MS_007	2010	642	
					1475	875	

Do Not Scale.

If In Doubt Ask!

Description: **Glazing System - Mann McGowan Panelled Doors - 7mm Pyroguard - FD30**

Drawn By: **O BOOY**

Approved: **Approved**

Date: **08/09/2025**

Drawing No:

Size: **See Above**

Tolerance: **+/- 0.5mm**

Fire Rating: **FD30S**

DP23728

Cert No: **PAR/2451/01**

© Doorpac Ltd

REV 00

